



ARQUITECTO RESPONSABLE:
 MATRÍCULA:

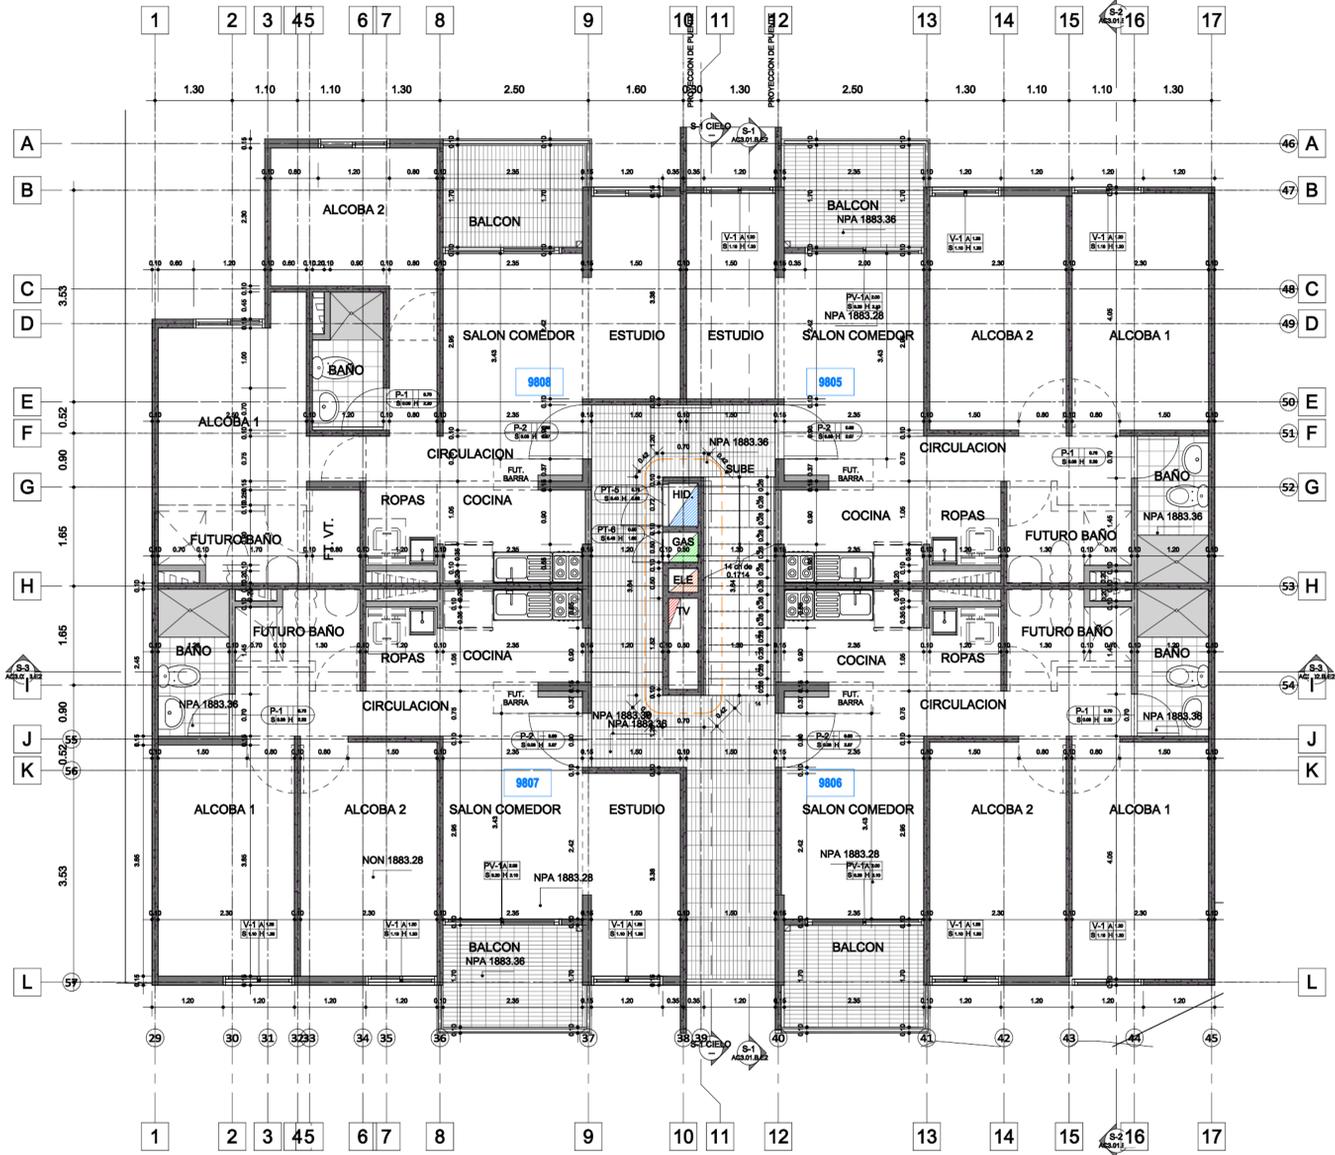


PLANTA PISO 98
 1 : 50



AREA CONSTRUIDA PISO 98		
NIVEL	APTO	AREA m²
P-98	9805	56.55
P-98	9806	50.92
P-98	9807	56.74
P-98	9808	54.55
P-98	CIRCULACION	22.81
TOTAL PISO: 5		241.57

DISTANCIA DE RECORRIDO K.3.6-1 NSR-10		DISTANCIA DE RECORRIDO K.3.6-1 NSR-10	
PISO 1	5.83	PISO 1	10.36
PISO 2	10.36	PISO 99	10.36
PISO 3	10.36	PISO 98	10.36
PISO 4	10.36	PISO 97	21.01
PISO 5	20.91	TOTAL	52.09
TOTAL	57.82		

CARGA DE OCUPACION K.3.3-1 NSR-10		CARGA DE OCUPACION K.3.3-1 NSR-10	
RESIDENCIAL	18	PISO 99	12.15
PISO 1	12.15	PISO 98	12.15
PISO 2	12.15	PISO 97	12.15
PISO 3	12.15	TOTAL	36.45
PISO 4	12.15		
PISO 5	12.15		
TOTAL	60.75		



NOTA: Se dispondrá de sistemas y equipos para la detección y extinción de incendios con base en los requisitos del título J de NSR-10
 NOTA: Distancia máx recorridos sin rociadores 60 m.