


ARQUITECTO RESPONSABLE:
 MATRÍCULA:



PLANTA PISO 99
 1 : 50

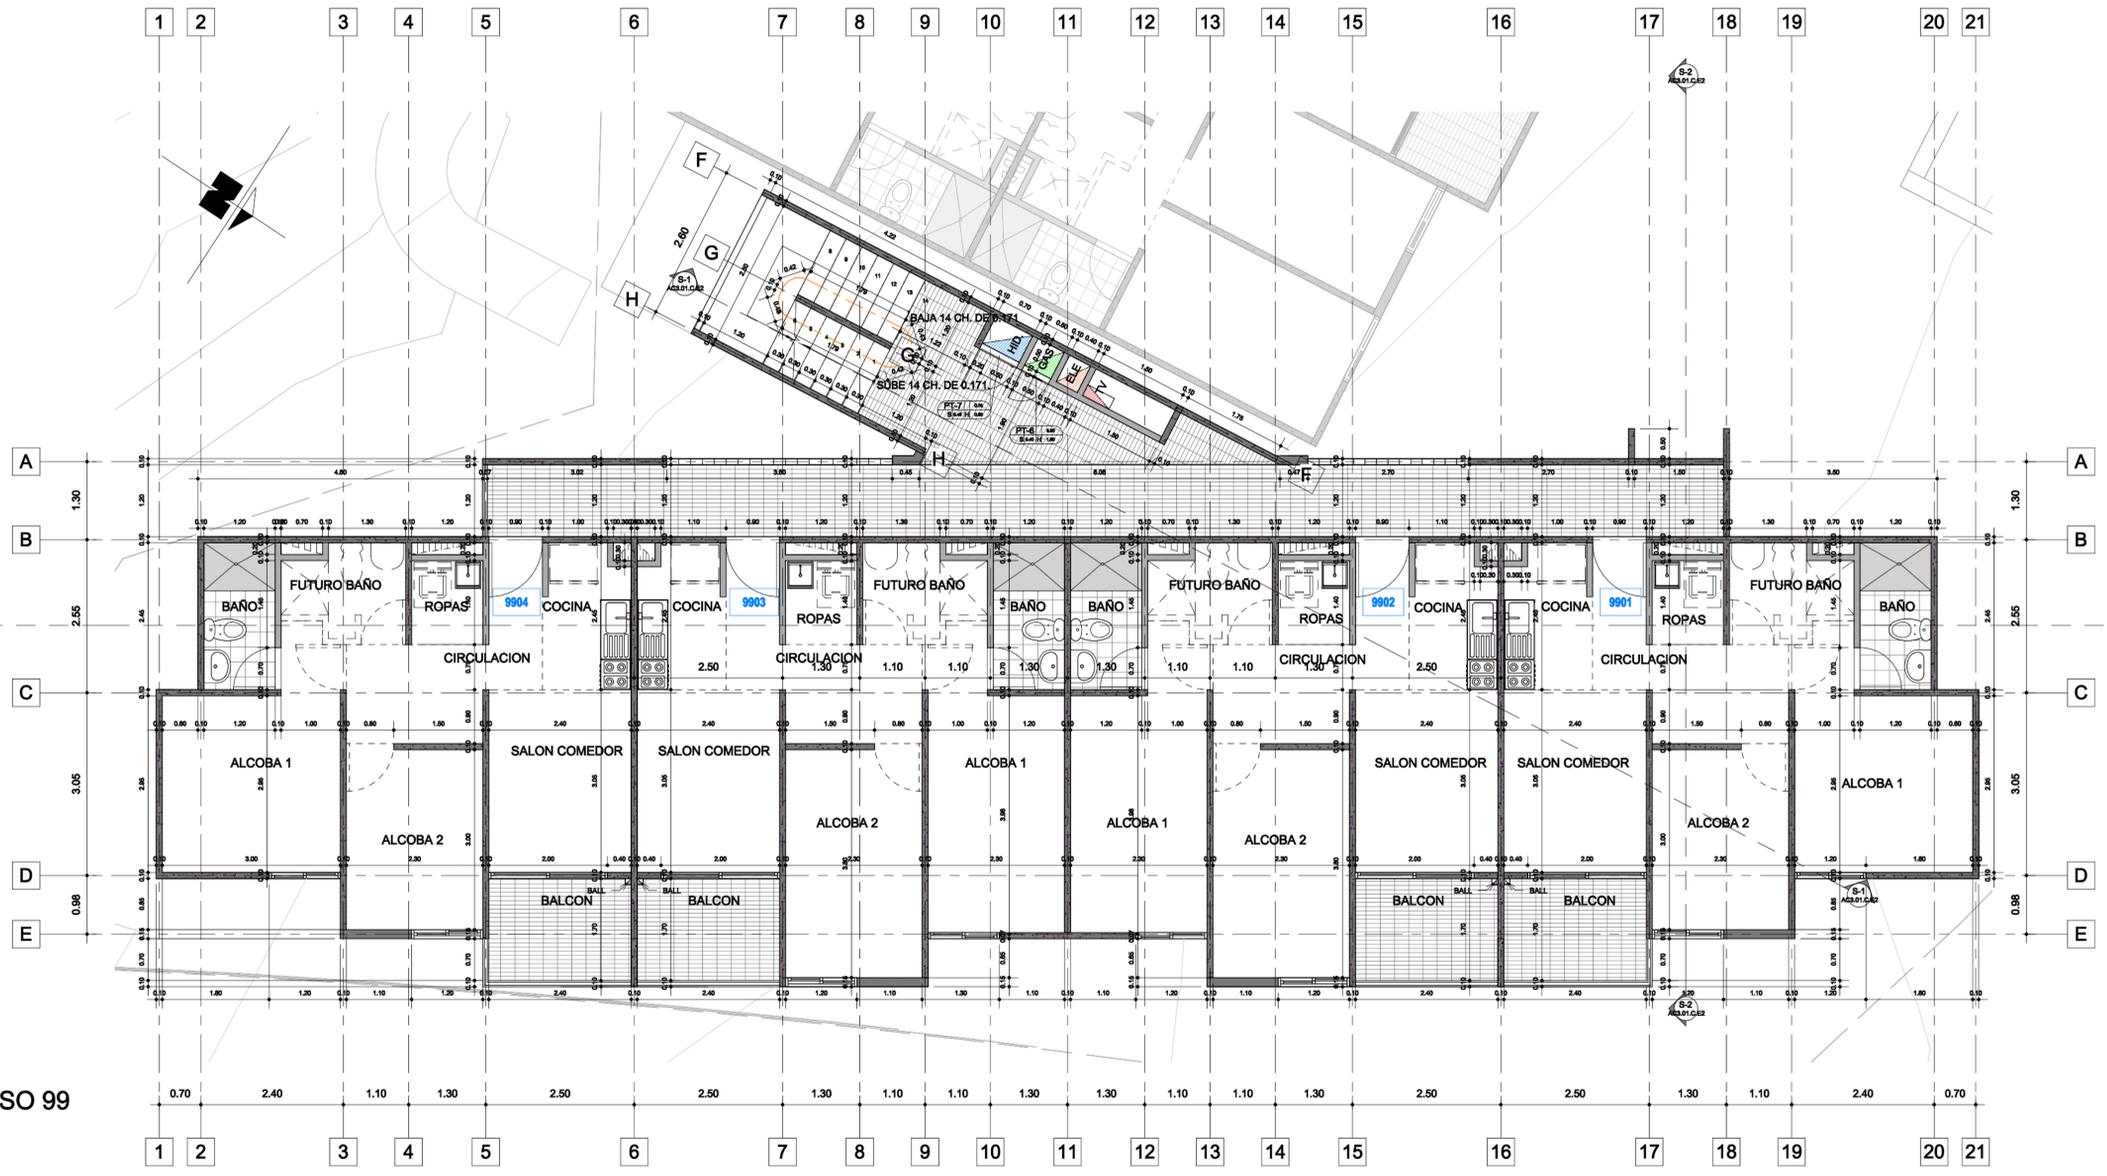

AREA CONSTRUIDA PISO 99		
NIVEL	APTO	AREA m²
P-99	9901	50.64
P-99	9902	52.42
P-99	9903	52.42
P-99	9904	50.64
P-99	CIRCULACION	45.20
TOTAL:	5	251.30

DISTANCIA DE RECORRIDO K.3.6-1 NSR-10		DISTANCIA DE RECORRIDO K.3.6-1 NSR-10	
PISO 1	14.01	PISO 1	14.01
PISO 2	5.46	PISO 99	5.46
PISO 3	5.46	PISO 98	5.46
PISO 4	5.46	PISO 97	27.12
PISO 5	27.09	TOTAL	52.05
TOTAL	57.48		

CARGA DE OCUPACION K.3.3-1 NSR-10		CARGA DE OCUPACION K.3.3-1 NSR-10	
RESIDENCIAL	18	PISO 99	11.45
PISO 1	11.45	PISO 98	11.45
PISO 2	11.45	PISO 97	11.45
PISO 3	11.45	TOTAL	34.35
PISO 4	11.45		
PISO 5	11.45		
TOTAL	57.25		

NOTA: Se dispondrá de sistemas y equipos para la detección y extinción de incendios con base en los requisitos del título J de NSR-10
 NOTA: Distancia máx recorrida sin rociadores 60 m.

